

Simplex FIRE PRODUCTS


Site Evacuation Panel Operators Guide

The panel is divided into two functions – Evacuation system & Phone system.
 The Evacuation functions are on the left side & Phone functions on the right.
 Activation from the fire panel will initiate an EVACUATION tone.
 The Evacuation controls will only work when the Keyswitch is in MANUAL position.

Stop Tones: Turn the Keyswitch to ISOLATE.

Make an Announcement: Turn the Keyswitch to MANUAL, press the appropriate BLUE key/s (LED/s will turn on), pick up the microphone & depress the push to talk switch (on the microphone).

Cancel a Tone or P.A: Press the appropriate key again – LED will turn off.

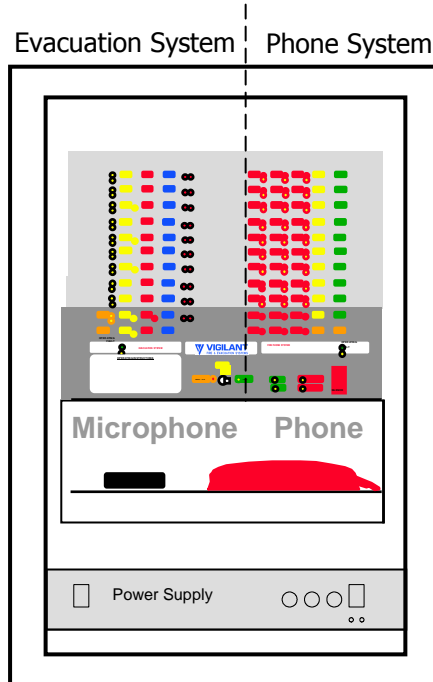

Call A Phone: Pick up the phone & press the appropriate RED key. Wait for remote phone to be answered.

Answer A Call: Pick up the phone & press the appropriate RED key – the LED will be flashing.

Cancel a Call: press the appropriate RED key again – LED will turn off.

- **To silence the Sounder,** press the SILENCE key.
 - **To reset the Automatic Evacuation,** reset the fire panel first, turn the Keyswitch to MANUAL, then keep the SILENCE key pressed for 5 seconds.
- When the Keyswitch is in ISOLATE position, all Evacuation controls behave the same as MANUAL, but no sound will be generated – used for training.*

Normally, the Keyswitch should be in the AUTO position.

